



Junction box

NOTE 7

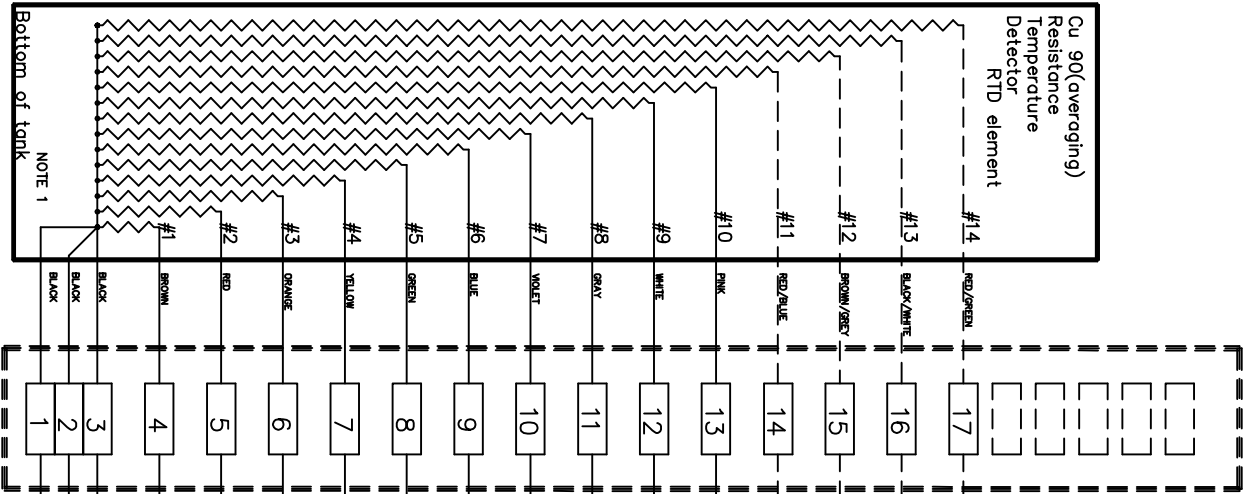

Data Acquisition Unit Slave

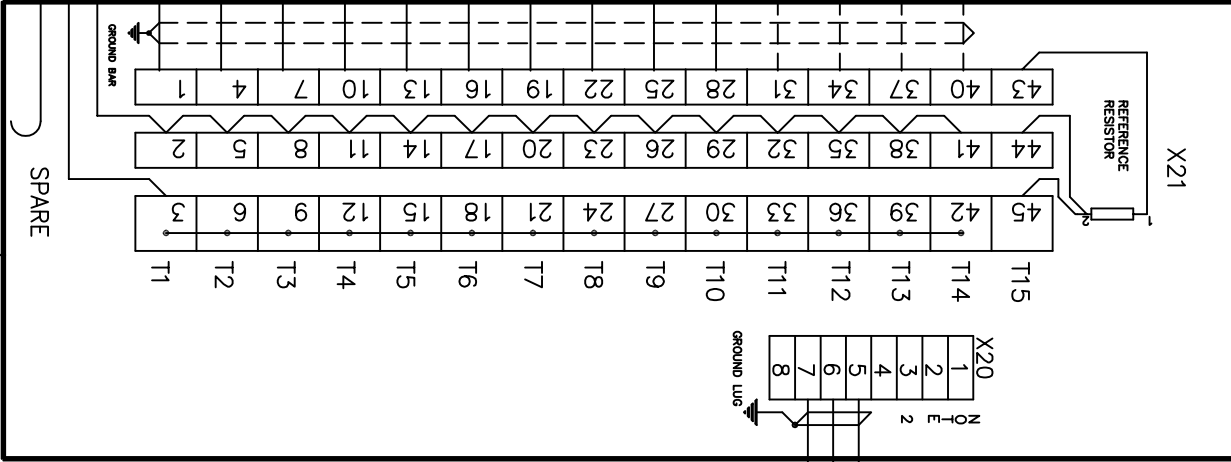

CASE IS TO BE EARTH CONNECTED

SEE ELECTRICAL INSTALLATION DWG FOR RTG

NOTE 6

NOTE 1
CONNECT RTDS TO MULTIPLEXER CHANNELS FROM THE BOTTOM UP. LEAVE UNUSED CHANNELS AT THE TOP.

NOTE 2
MAKE NO CONNECTIONS TO TERMINALS 1,2,3,4 OR 8 OF X20.

NOTE 6
MAX 50 M SHIELDED CABLE MIN AWG 20 OR 0.5 SQ. MM.
L_{max} = 0.6 mH; C_{max} = 3 uF. (VALID FOR GENVELEC IIB)
(CUSTOMER SUPPLY)
FOR FURTHER INFORMATION, SEE ACTUAL CERTIFICATE.

NOTE 7
CUSTOMER SUPPLY. (OPTIONAL RTR SUPPLY)
JUNCTION BOX MAY BE EXCLUDED DEPENDING ON LOCAL CONDITIONS

HAZARDOUS AREA

| | | | | | | | | | | | | | |
|--|-----|------|------|------------------|------|---------|-------|----------------------------|--------------------------|-------|---------|-------|---------|
| ISSUED BY | GKM | WEEK | 9137 | PRODUCT CODE | REX | TITLE | ACAD | INSTALLATION DRAWING TITLE | EL. INSTALLATION DRAWING | ISSUE | 5 | SHEET | 1/1 |
| APPROVED BY | GKT | WEEK | 9138 | ORIGINAL DWG NO. | 9240 | 002-909 | SCALE | 1 ST ANGLE | DOC TYPE | 2 | DWG NO. | 9240 | 002-909 |
| <p>ROSEMOUNT</p> <p>Tank Gauging</p> <p>THE COMPANY/CONTRACTOR OF THIS DOCUMENT IS AND WILL REMAIN LIABLE FOR THE CORRECTNESS OF THE INFORMATION PROVIDED AND FOR THE ACCURACY OF THE DATA. THE COMPANY/CONTRACTOR WILL NOT BE RESPONSIBLE FOR THE USE OF THIS DOCUMENT BY ANY OTHER PARTY. THE COMPANY/CONTRACTOR WILL NOT BE RESPONSIBLE FOR THE USE OF THIS DOCUMENT BY ANY OTHER PARTY. THE COMPANY/CONTRACTOR WILL NOT BE RESPONSIBLE FOR THE USE OF THIS DOCUMENT BY ANY OTHER PARTY.</p> | | | | | | | | | | | | | |