


EXTENSION CABLE
(CUSTOMER SUPPLY)
MAX 50 M WITH
AN OUTER SHIELD.

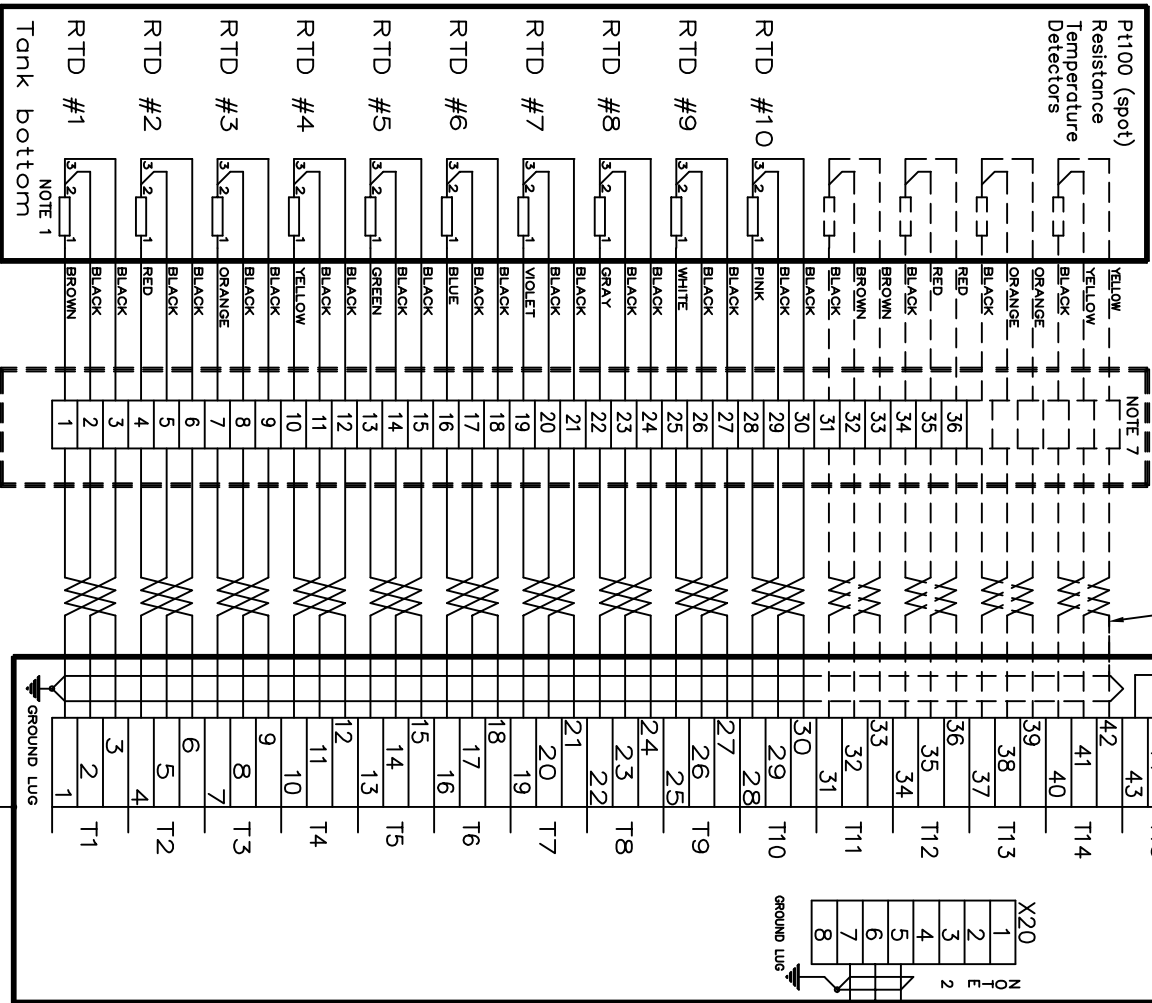

CASE IS TO BE EARTH CONNECTED

SEE ELECTRICAL
INSTALLATION
DWG FOR RTG

HAZARDOUS AREA

NOTE 1
CONNECT RTDS TO MULTIPLEXER CHANNELS FROM THE
BOTTOM UP. LEAVE UNUSED CHANNELS AT THE TOP.

NOTE 2
MAKE NO CONNECTIONS TO TERMINALS 1,2,3,4 OR 8 OF X20.

NOTE 6
MAX 50M SHIELDED CABLE MIN AWG 20 OR 0.5 SQ MM.
($I_{max} = 0.6 \text{ mH}$, $C_{max} = 3 \text{ uF}$. (VALID FOR CENELEC IIB)
(CUSTOMER SUPPLY)
FOR FURTHER INFORMATION, SEE ACTUAL CERTIFICATE.

NOTE 7
CUSTOMER SUPPLY (OPTIONAL RTR SUPPLY JB15 OR JB36)

ISSUED BY	GKM	WEEK	9137	PRODUCT CODE	REX	FILE	ACAD	INSTALLATION DRAWING TITLE	EL. INSTALLTION DRAWING	ISSUE	7	SHEET	1/1
APPROVED BY	GKT	WEEK	9138	ORIGINAL DWG NO.	9240	002-910	SCALE	SDAU-P1100 3-WIRE					
ROSEMOUNT		1 ST ANGLE		DOC TYPE		2		9240 002-910		7		1/1	
<small>THE COMPANY ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THE INFORMATION CONTAINED HEREIN. THE INFORMATION IS PROVIDED AS IS WITHOUT WARRANTY OF ANY KIND. THE COMPANY SHALL NOT BE RESPONSIBLE FOR ANY DAMAGE, INCLUDING CONSEQUENTIAL DAMAGES, ARISING FROM THE USE OF THE INFORMATION CONTAINED HEREIN. THE COMPANY SHALL NOT BE RESPONSIBLE FOR ANY DAMAGE, INCLUDING CONSEQUENTIAL DAMAGES, ARISING FROM THE USE OF THE INFORMATION CONTAINED HEREIN. THE COMPANY SHALL NOT BE RESPONSIBLE FOR ANY DAMAGE, INCLUDING CONSEQUENTIAL DAMAGES, ARISING FROM THE USE OF THE INFORMATION CONTAINED HEREIN.</small>													